


CHIP CONCRETE BACK A MINIMUM OF 3" (76.2mm)
FOR TRANSITION WITH A 1/2" (12.7mm) DEPTH.

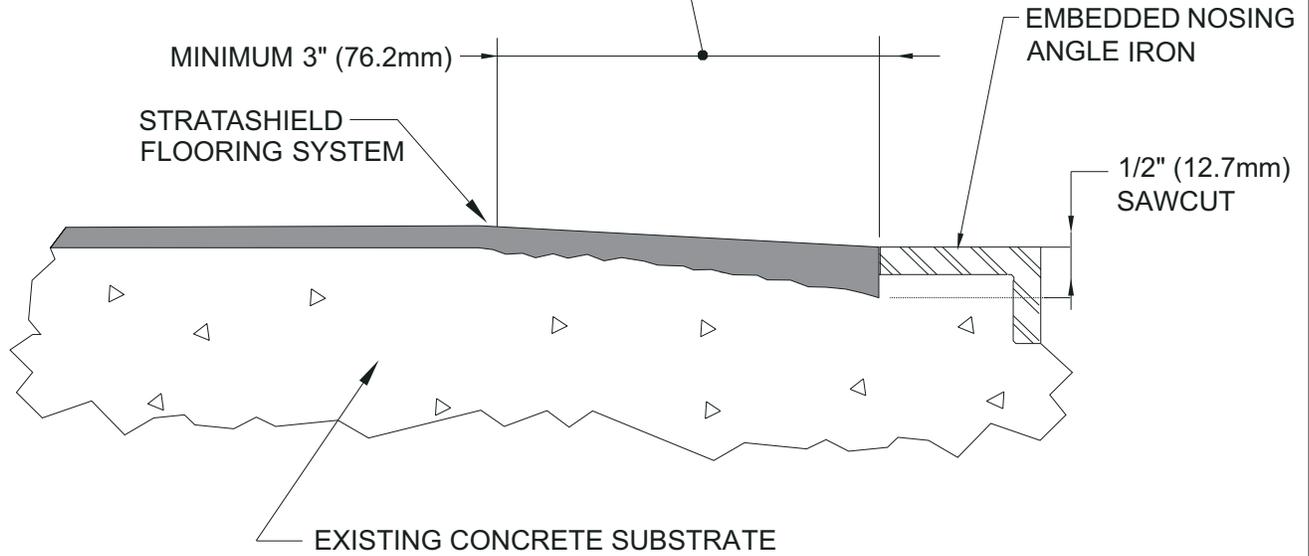

TNEMEC STRATASHIELD STANDARD FLOORING DETAILS

TERMINATION DETAIL FOR MORTAR AT
NOSE ANGLE IRON AT LOADING DOCK
OR BUILDING JOINT

NO. SFS-03

REV.0